



UL INTERNATIONAL (UK) LTD
 Womersley House, Building C,
 The Guildway,
 Old Portsmouth Road,
 Guildford. GU3 1LR.
 United Kingdom.



designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, www.eota.eu)

European Technical Assessment

ETA 18/0925
of 12/12/2018

Technical Assessment Body issuing the ETA and designated according to Article 29 of the Regulation (EU) No 305/2011: **UL International (UK) Ltd**

Trade name of the construction product Knauf FP Service Transit

Product family to which the construction product belongs Fire Stopping and Sealing Product:
 • Penetration Seals

Manufacturer Knauf Sp. z o.o.
 ul. Światowa 25
 02-229 Warsaw
 Poland

Manufacturing plant(s) A/003

This European Technical Assessment contains 18 pages including 1 Annex which forms an integral part of this assessment.

This European Technical Assessment is issued in accordance with regulation (EU) No 305/2011, on the basis of EAD 350454-00-1104, September 2017.

Translations of this European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of this European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made, with the written consent of the issuing Technical Assessment Body. Any partial reproduction has to be identified as such.

Table of Contents

I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT	3
1 Technical description of the product	3
2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104.....	3
3 Performance of the product and references to the methods used for its assessment	5
4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE.....	6
5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD	6
6 Issued on:.....	7
ANNEX A – Resistance to Fire Classification – Knauf FP Service Transit	8
A.1 Flexible or rigid wall constructions with wall thickness of minimum 75 mm	8
A.1.1 Penetration seals, in drywalls (min. 1 x 12.5 mm board per side) and concrete/masonry walls.....	8
A.2 Flexible or rigid wall constructions with wall thickness of minimum 100 mm	10
A.2.1 Penetration seals, in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls.....	10
A.2.2 Penetration seals, in 100 mm thick Knauf FPC panel 1-S seals in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls.....	12
A.3 Rigid walls constructions with wall thickness of minimum 150 mm	13
A.3.1 Penetration seals in concrete/masonry walls	13
A.3.2 Penetration seals, in 150 mm thick Knauf FPC panel 2-S seals (including 30 mm air gap) in concrete/masonry walls	15
A.4 Rigid floor constructions with thickness of minimum 150 mm	16
A.4.1 Penetration seals in concrete/masonry floors	16
A.4.2 Penetration seals, in 50 mm thick Knauf FPM – fire protection mortar seals (with 50 mm stone wool backer) in concrete/masonry floors.....	18

I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

1 Technical description of the product

- 1) Knauf FP Service Transit is a cable box device used to form penetration seals where cables and conduits penetrate walls and floors.
- 2) The Knauf FP Service Transit is supplied with intumescent liner complete within a hinged Polypropylene shell, to be closed around the services and inserted into the aperture in the supporting element.
- 3) The applicant has submitted a written declaration that the product and/or constituents of the product contains no substances which have been classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No. 1272/2008 and listed in the 'indicative list on dangerous substances' of the EGDS – taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European Technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 4) The use category of Knauf FP Service Transit in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3

2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350454-00-1104

Detailed information and data is given in Annex A.

The intended use of system Knauf FP Service Transit is to reinstate the fire resistance performance of flexible wall and rigid wall and floor constructions, where they are penetrated by services.

- 1) The specific elements of construction that the system Knauf FP Service Transit may be used to provide a penetration seal in, are as follows:

Flexible walls: The wall must have a minimum thickness of 75 mm and comprise steel studs lined on both faces with minimum 1 layer of 12.5 mm thick boards.

Rigid walls: The wall must have a minimum thickness of 75 mm and comprise concrete, aerated concrete or masonry, with a minimum density of 650 kg/m³.

Rigid floors: The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m³.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

- 2) The system Knauf FP Service Transit may be used to provide a penetration seal with specific supporting constructions and substrates (for details see Annex A).

- 3) The provisions made in this European Technical Assessment are based on an assumed working life of the Knauf FP Service Transit of 30 years, provided that the conditions laid down in the manufacturers datasheet and instructions for the packaging/transport/storage/installation/use/repair are met. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.
- 4) Type Z₂: intended for use at internal conditions with humidity classes other than Z₁, excluding temperatures below 0°C.

Specimen
conform cu originalul
Nu poate fi folosit ca document oficial

3 Performance of the product and references to the methods used for its assessment

Product-type: Pipe Service Transit		Intended use: Penetration Seal
Assessment method	Essential characteristic	Product performance
BWR 2 Safety in case of fire		
EN 13501-1	Reaction to fire	Performance not assessed
EN 13501-2	Resistance to fire	Annex A
BWR 3 Hygiene, health and environment		
EN 1026	Air permeability	No performance determined
EAD 350454-00-1104, Annex C	Water permeability	No performance determined
Declaration of manufacturer & EN 16516	Content, emission and/or release of dangerous substances	Use categories: IA1, S/W3 Declaration of manufacturer
BWR 4 Safety in use		
EOTA TR 001:2003	Mechanical resistance and stability	No performance determined
EOTA TR 001:2003	Resistance to impact/movement	No performance determined
EOTA TR 001:2003	Adhesion	No performance determined
EAD 350454-00-1104, Clause 2.2.9	Durability	Z ₂
BWR 5 Protection against noise		
EN 10140-1,2,4,5/ EN ISO 717-1	Airborne sound insulation	No performance determined
BWR 6 Energy economy and heat retention		
EN 12664, EN 12667, EN 12939, EN ISO 8990, EN ISO 6946, EN ISO 14683, EN ISO 10211, EN ISO 10456	Thermal properties	No performance determined
EN ISO 12572, EN 12086, EN ISO 10456	Water vapour permeability	No performance determined

4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see <http://eur-lex.europa.eu/JOIndex.do> of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

Product(s)	Intended use(s)	Level(s) or class(es)	System(s)
Fire stopping and Fire Sealing Products	For fire compartmentation and/or fire protection or fire performance	Any	1

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

Tasks of the manufacturer:

Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European Technical Assessment.

The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 6th May 2014 relating to the European Technical Assessment ETA 18/0925 issued on 12/12/18 which is part of the technical documentation of this European Technical Assessment. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (UK) Ltd.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.

¹ Official Journal of the European Communities L178/52 of 14/7/1999

Other tasks of the manufacturer

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

(a) Technical data sheet:

- Field of application:
- Building elements for which the penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
- Limits in size, minimum thickness etc. of the penetration seal
- Construction of the penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.

(b) Installation instruction:

- Steps to be followed
- Procedure in case of retrofitting
- Stipulations on maintenance, repair and replacement

6 Issued on:

12th December 2018

CRReport by:



D. Yates
Project Engineer
Building and Life Safety Technologies

Reviewed by:



C. Johnson
Staff Engineer
Building and Life Safety Technologies


For and on behalf of UL International (UK) Ltd.

ANNEX A – Resistance to Fire Classification – Knauf FP Service Transit

A.1 Flexible or rigid wall constructions with wall thickness of minimum 75 mm

A.1.1 Penetration seals, in drywalls (min. 1 x 12.5 mm board per side) and concrete/masonry walls

Penetration Seal: Cables and conduits fitted with 150 mm long Knauf FP Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between seals (a_2) = 30 mm. Min. Separation between seals (a_2) = 30 mm, min. Separation between transit and supporting construction (a_1) = 0 mm.

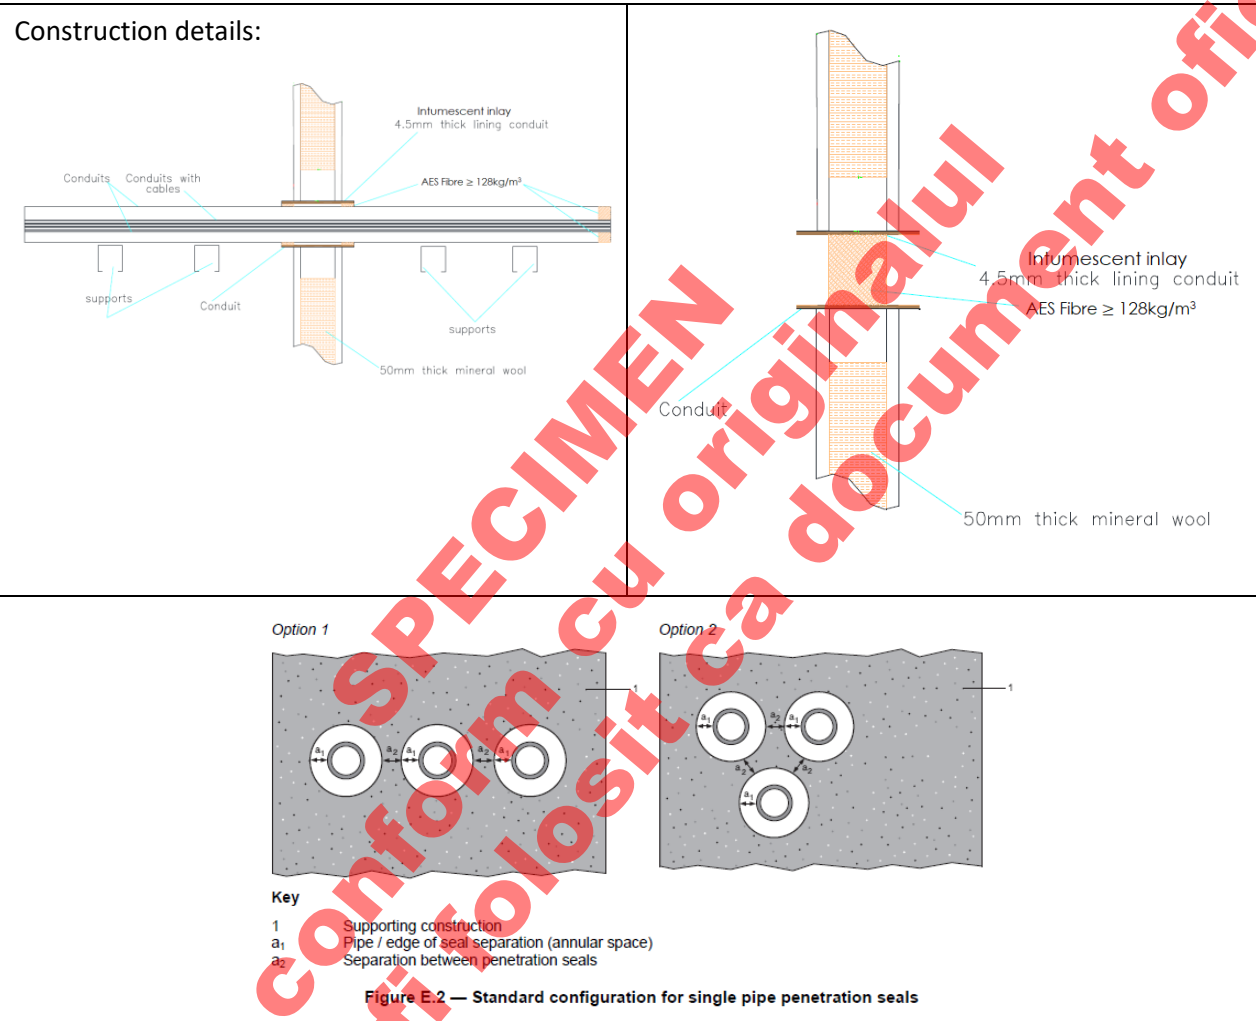

A.1.1.1


Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 150 mm long	40 mm Ø x 150 mm long	EI 60
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 150 mm long	63 mm Ø x 150 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 150 mm long	90 mm Ø x 150 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 150 mm long	110 mm Ø x 150 mm long	
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 60 EI 30
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 60 U/C

SPECIMEN
 conform cu originalul
 Nu poate fi folosit ca document oficial

A.2 Flexible or rigid wall constructions with wall thickness of minimum 100 mm

A.2.1 Penetration seals, in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between seals (a_2) = 30 mm, min. Separation between transit and supporting construction (a_1) = 0 mm A.2.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.2.1.2.

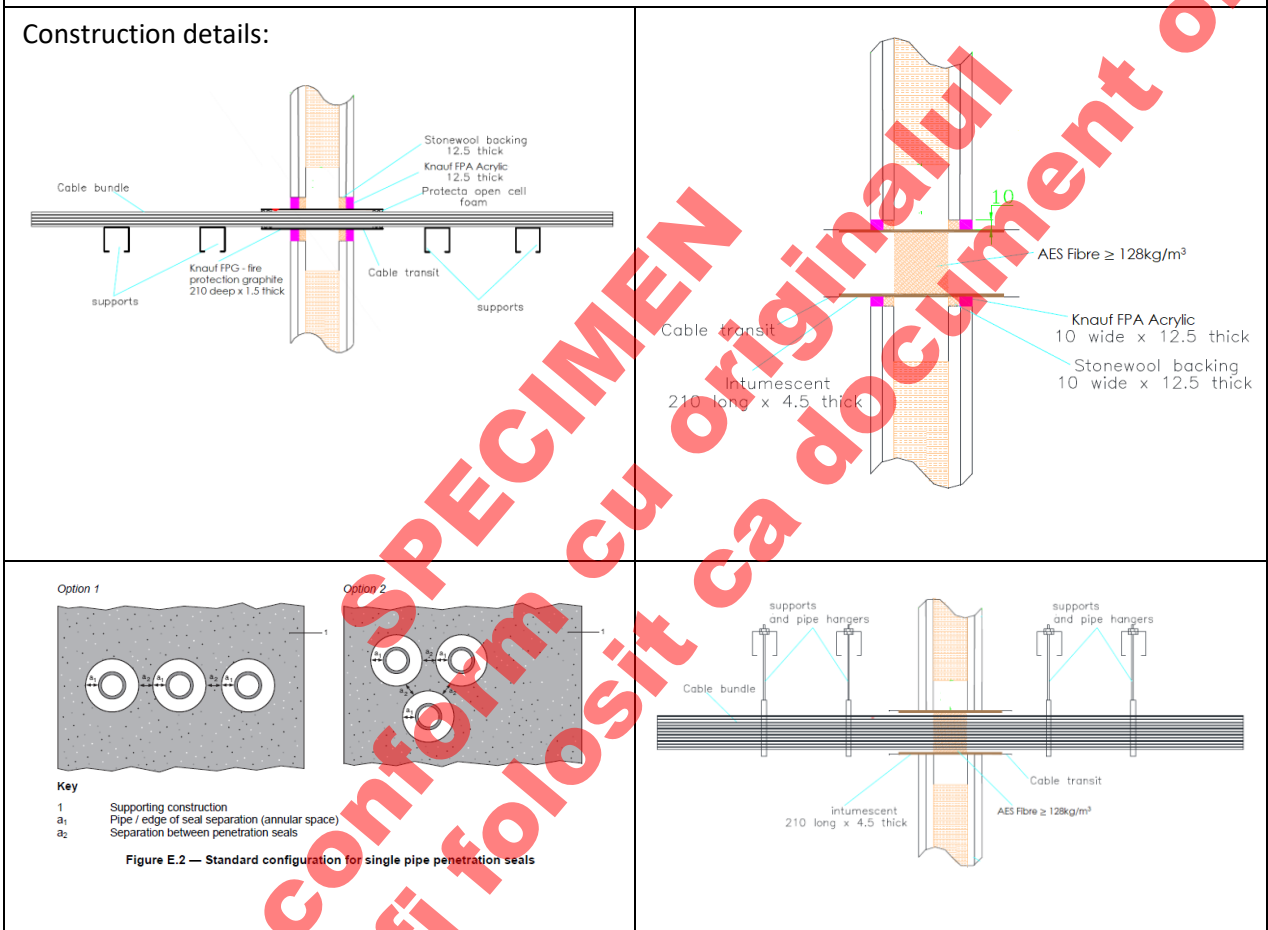

A.2.1.1 – Knauf FP Service Transit friction fitted into wall

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 90
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 90 EI 60
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 90 U/C

A.2.1.2 – Knauf FP Service Transit in minimum 20 mm oversize aperture fitted with Knauf FPA Acrylic.

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 90
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	EI 90
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 90 U/C

A.2.2 Penetration seals, in 100 mm thick Knauf FPC panel 1-S seals in drywalls (min. 2 x 12.5 mm board per side) and concrete/masonry walls

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between transits and between transits and the edges of the board seal (a_1, a_2, a_3) = 30 mm, min.

Construction details:

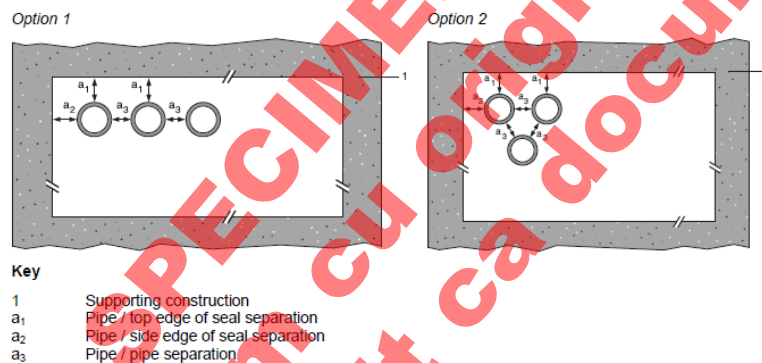
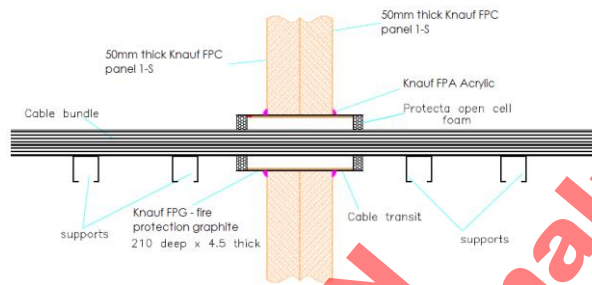


Figure E.1 — Standard configuration for multiple pipe penetration seals


A.2.2.1

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm \varnothing x 250 mm long	EI 90
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm \varnothing x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm \varnothing x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm \varnothing x 250 mm long	
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 90 EI 60
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 90 U/C

A.3 Rigid walls constructions with wall thickness of minimum 150 mm

A.3.1 Penetration seals in concrete/masonry walls

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the wall. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between seals (a_2) = 30 mm, min. Separation between transit and supporting construction (a_1) = 0 mm A.3.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.3.1.2.

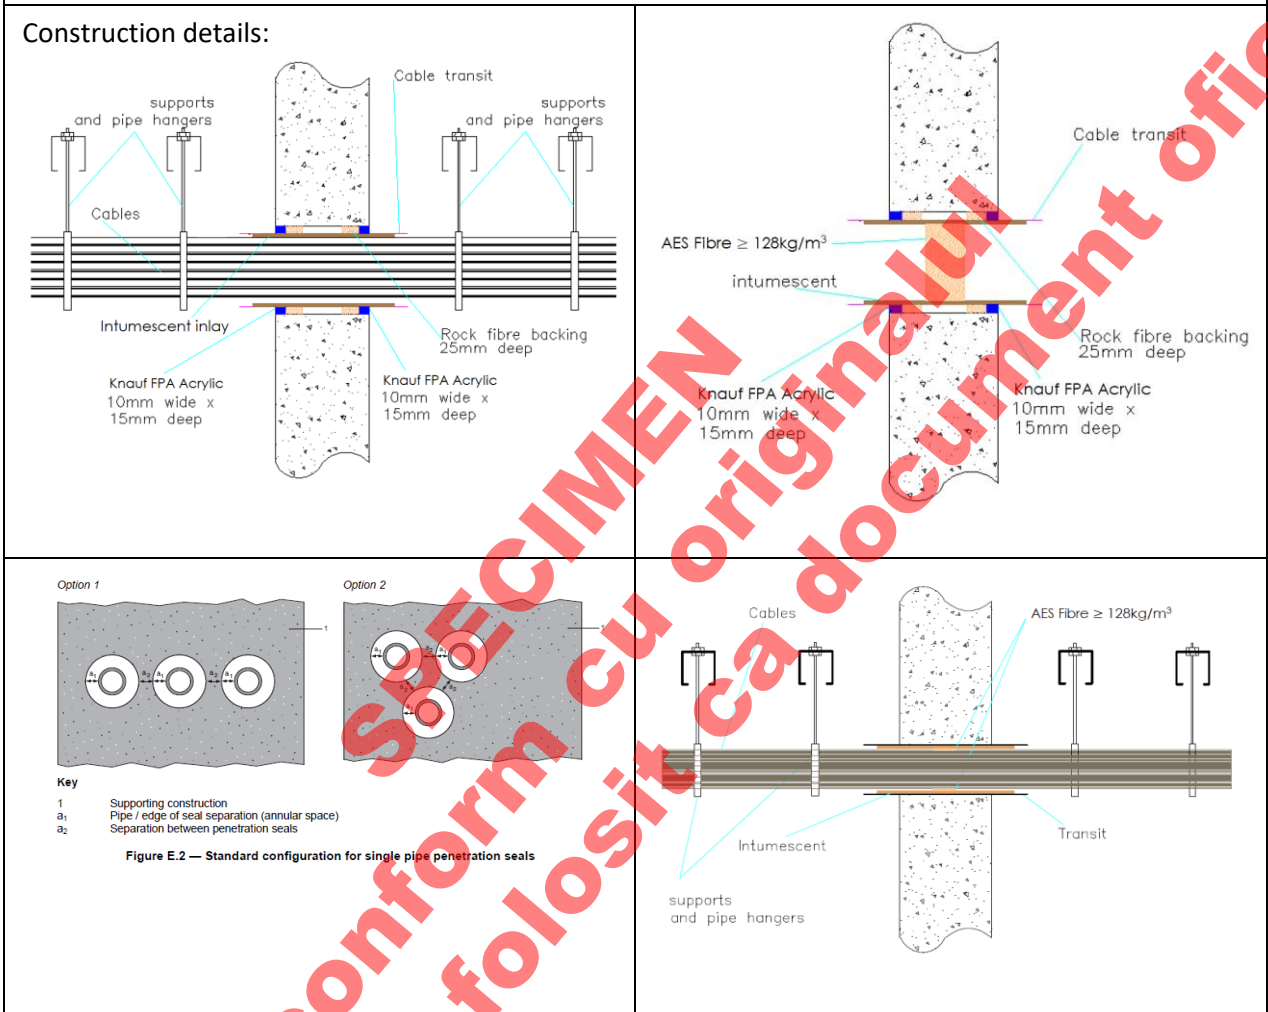

A.3.1.1 – Knauf FP Service Transit friction fitted into wall



Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 240
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	E 240 EI 180
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 90
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 240 U/C

A.3.1.2 – Knauf FP Service Transit in minimum 20 mm oversize aperture fitted with Knauf FPA Acrylic.

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 240
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	E 240 EI 180
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 90
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 240 U/C

A.3.2 Penetration seals, in 150 mm thick Knauf FPC panel 2-S seals (including 30 mm air gap) in concrete/masonry walls

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between transits and between transits and the edges of the board seal (a_1, a_2, a_3) = 30 mm, min.

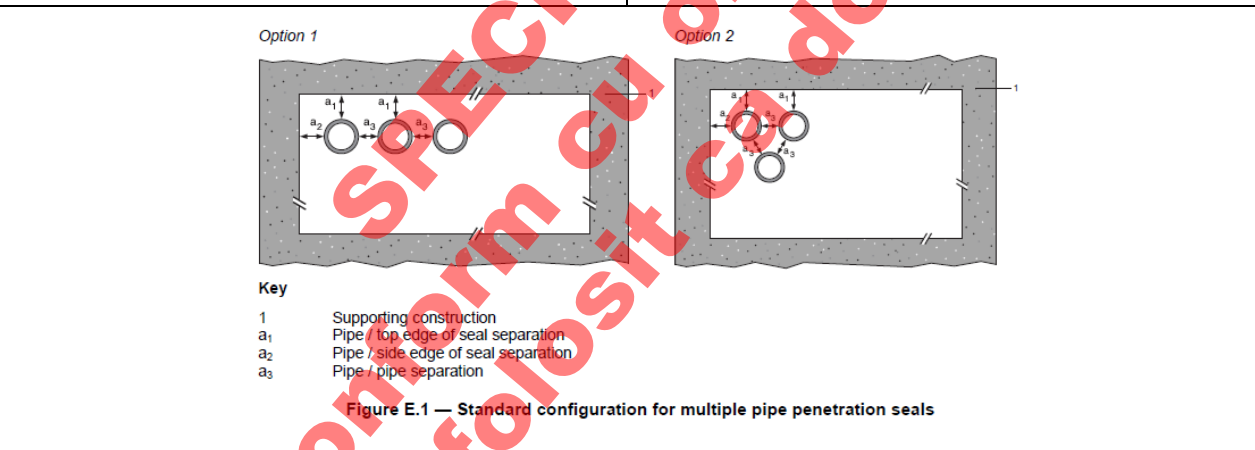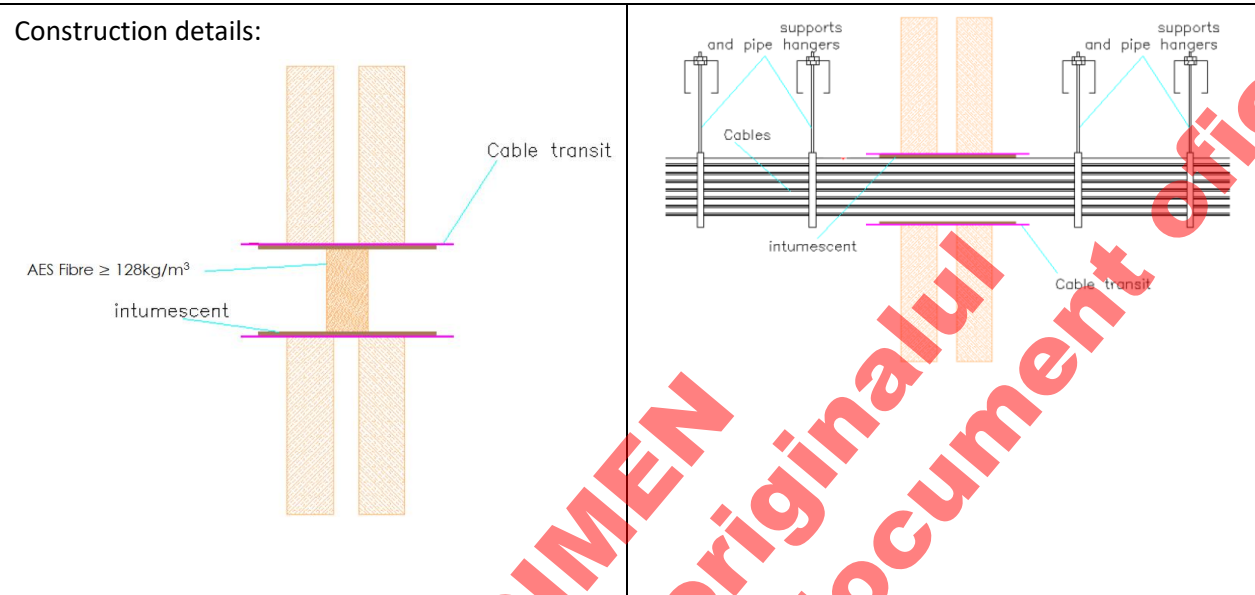


A.3.2.1

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm \varnothing x 250 mm long	E 240 EI 180
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm \varnothing x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm \varnothing x 250 mm long	E 180 EI 120
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm \varnothing x 250 mm long	E 240 EI 120
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 90
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			EI 90 U/C

A.4 Rigid floor constructions with thickness of minimum 150 mm

A.4.1 Penetration seals in concrete/masonry floors

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the floor. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between seals (a_2) = 30 mm, min. Separation between transit and supporting construction (a_1) = 0 mm A.4.1.1 and minimum 10 mm with maximum aperture 300 x 300mm A.4.1.2.

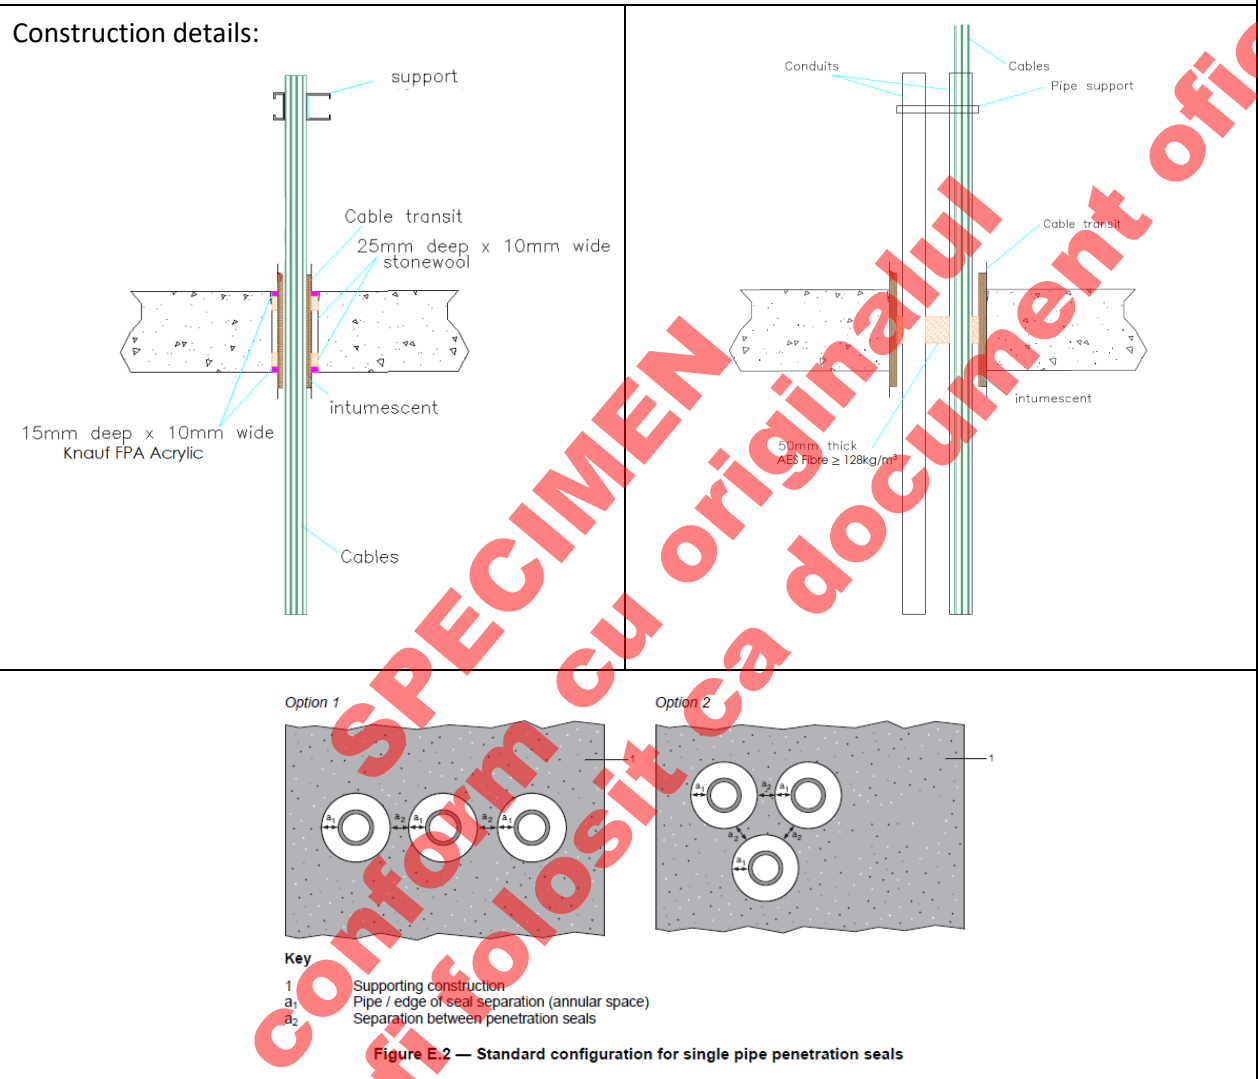

A.4.1.1 – Knauf FP Service Transit friction fitted into floor



Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 180
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 180
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			E 120 C/U EI 60 C/U

A.4.1.2 – Knauf FP Service Transit in minimum 20 mm oversize aperture fitted with Knauf FPA Acrylic.

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm Ø x 250 mm long	EI 240
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm Ø x 250 mm long	E 240 EI 180
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm Ø x 250 mm long	EI 240
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm Ø x 250 mm long	EI 180
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 180
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			E 120 C/U EI 60 C/U

A.4.2 Penetration seals, in 50 mm thick Knauf FPM – fire protection mortar seals (with 50 mm stone wool backer) in concrete/masonry floors

Penetration Seal: Cables and conduits fitted with 250 mm long Knauf FP Service Transit, central within the seal. Spaces around cables and conduits within the device are sealed with 50 mm deep AES Fibre $\geq 128\text{kg/m}^3$ installed centrally. Min. Separation between transits and between transits and the edges of the board seal (a_1, a_2, a_3) = 30 mm, min.

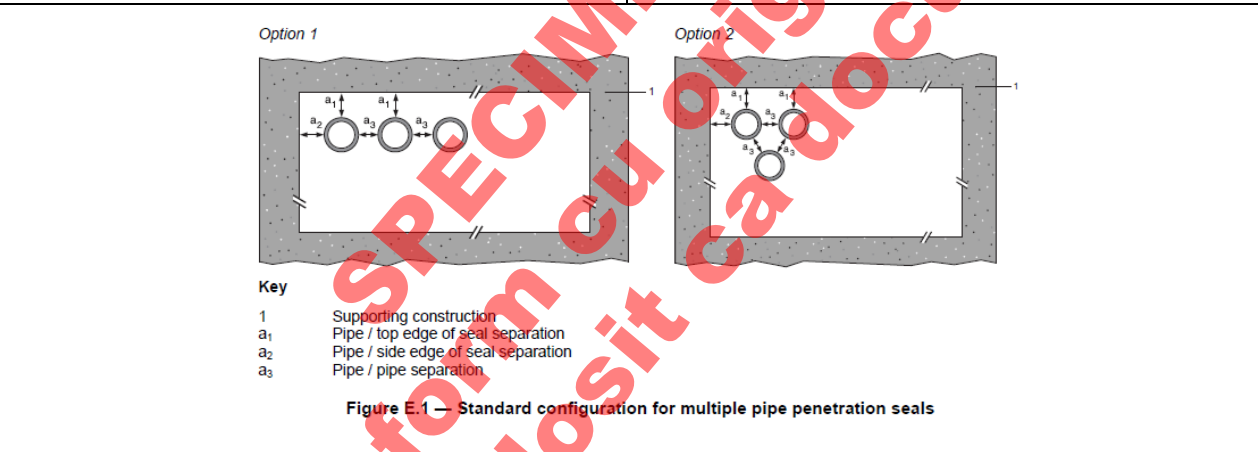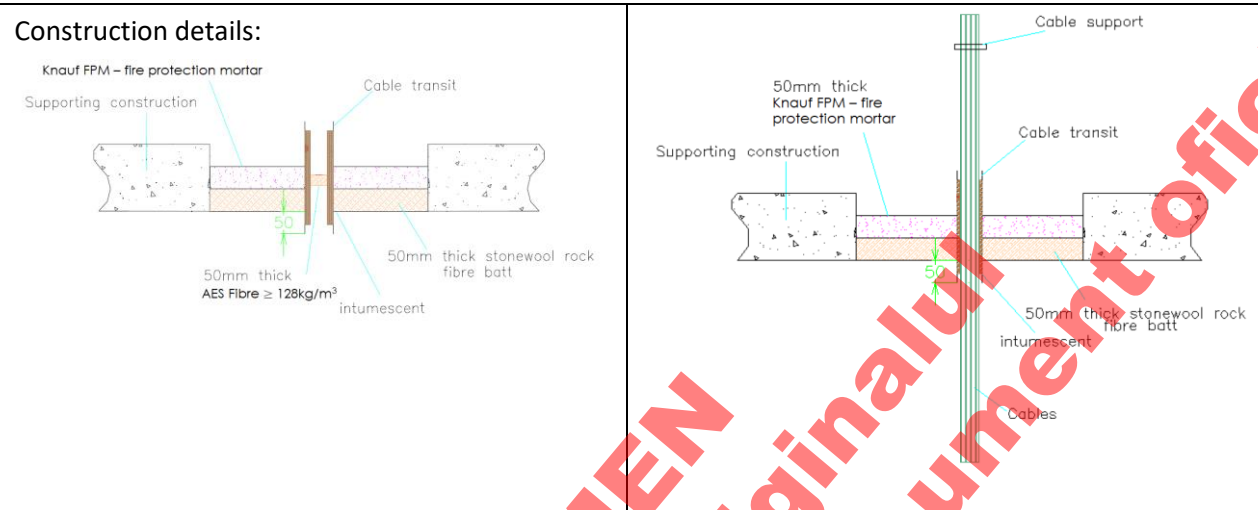

A.4.2.1

Services	Inlay size	Transit size	Classification
Up to 35 mm diameter bundle of cables up to 14 mm diameter	1.5 mm thick by 210 mm long	40 mm \varnothing x 250 mm long	EI 240
Up to 50 mm diameter bundle of cables up to 14 mm diameter	2.0 mm thick by 210 mm long	63 mm \varnothing x 250 mm long	EI 180
Up to 80 mm diameter bundle of cables up to 14 mm diameter	4.0 mm thick by 210 mm long	90 mm \varnothing x 250 mm long	E 240 EI 120
Up to 100 mm diameter bundle of cables up to 14 mm diameter	4.5 mm thick by 210 mm long	110 mm \varnothing x 250 mm long	EI 120
Empty filled at mid-depth with 50 mm deep plug of AES Fibre $\geq 128\text{kg/m}^3$	All inlay sizes specified above	All transit sizes specified above	E 240 EI 180
Up to 32mm diameter plastic pipes in bundle, empty or with penetrating bundle of cables up to 14 mm diameter			E 120 C/U EI 60 C/U