





designated according to Article 29 of the Regulation (EU) No 305/2011 and member of EOTA (European Organisation for Technical Assessment, www.eota.eu)



Table of Contents

| 1 Technical description of the product 3 2 Specification of the intended uses of the product in accordance with the applicable European Assessment Document (Hereinafter EAD): EAD 350141-00-1106, September 2017. 3 3 Performance of the product and references to the methods used for its assessment 5 4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO IT'S LEGAL BASE. 6 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD 6 6 Issued on: 7 ANNEX A – Resistance to Fire Classification – Knauf FPA Acrylic. 8 A.1 Flexible wall constructions according to 2.1 with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm beard per side 8 A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. 9 A.3 Rigid Wall constructions according to 1.2.1 with wall thickness of minimum 150 mm. 11 A.3 Linear joint seals, between head of flexible wall and soffit of concrete floor / between rigid walls. 11 A.4 Rigid |
|---|
| EAD): EAD 350141-00-1106, September 2017 3 3 Performance of the product and references to the methods used for its assessment 5 4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE 6 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD 6 6 Issued on: 6 ANNEX A - Resistance to Fire Classification - Knauf FPA Acrylic 8 A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall 9 A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side 9 A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per wall 9 A.3 Rigid floor constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per wall 9 A.3 R |
| 4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE |
| ITS LEGAL BASE 6 5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD 6 6 Issued on: 7 ANNEX A - Resistance to Fire Classification - Knauf FPA Acrylic. 8 A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm A.3 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm 11 |
| 6 Issued on: 7 ANNEX A - Resistance to Fire Classification - Knauf FPA Acrylic. 8 A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm |
| ANNEX A – Resistance to Fire Classification – Knauf FPA Acrylic. 8 A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm A.3 Rigid vall constructions according to 1.2.1 with wall thickness of minimum 150 mm A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm |
| A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side 8 A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. 8 A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall. 9 A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm 11 A.3 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls. 11 A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm 12 |
| side 8 A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall 8 A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall 9 A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm 11 A.3 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls 11 A.3 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm 11 A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm 12 |
| wall 8 A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall 9 A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm 11 A.3.1 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls 11 A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm 12 |
| side 9 A.2.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall |
| wall |
| A.3.1Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls |
| A.3.1Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls |
| A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm |
| |
| |
| |
| ETA 18/0933 of 12/12/2018 – Page 2 of 12 |

I. SPECIFIC PARTS OF THE EUROPEAN TECHNICAL ASSESSMENT

1 <u>Technical description of the product</u>

- 1) Knauf FPA Acrylic is a sealant used to form linear gap seals where gaps are present in wall and floor constructions and linear joint seals where wall and floor constructions abut.
- 2) The Knauf FPA Acrylic is supplied in liquid form contained within 310 & 380 ml cartridges and 600 ml foil packs. The sealant is gunned into the aperture in the separating element/elements and around the service or services, to a specified depth utilising mineral fibre insulation backing material.
- Knauf FPA Acrylic contains no carcinogenic substances or mutagenic substances, flame retardants or antimicrobiological agents.
- 4) The applicant has submitted a written declaration that Knauf FPA Acrylic does not contain substances which have to be classified as dangerous according to Directive 67/548/EEC and Regulation (EC) No 1272/2008 and listed in the "Indicative list on dangerous substances" of the EGDS taking into account the installation conditions of the construction product and the release scenarios resulting from there.

In addition to the specific clauses relating to dangerous substances contained in this European technical Assessment, there may be other requirements applicable to the products falling within its scope (e.g. transposed European legislation and national laws, regulations and administrative provisions). In order to meet the provisions of the Construction Products Regulation, these requirements need also to be complied with, when and where they apply.

- 5) The use category of Knauf FPA Acrylic in relation to BWR 3 (Hygiene, health and environment) is IA1, S/W3
- 2 <u>Specification of the intended uses of the product in accordance with the applicable European Assessment</u> <u>Document (Hereinafter EAD): EAD 350141-00-1106, September 2017</u>

Detailed information and data is given in Annex A.

The intended use of system Knauf FPA Acrylic is to reinstate the fire resistance performance of gaps in and joints in and between flexible wall and rigid wall constructions, gaps in and joints between rigid floor constructions.

1) The specific elements of construction that the system Knauf FPA Acrylic may be used to provide a gap or joint seal in, are as follows:

Rigid walls:

Flexible walls:

The wall must have a minimum thickness of 75 mm and comprise steel studs lined on both faces with minimum 1 layers of 12.5 mm thick boards. The wall is permitted with or without insulation material between the boards. The wall must have a minimum thickness of 150 mm and comprise concrete,

Rigid floors:

aerated concrete or masonry, with a minimum density of 650 kg/m3. The floor must have a minimum thickness of 150 mm and comprise aerated concrete or concrete with a minimum density of 650 kg/m3.

The supporting construction must be classified in accordance with EN 13501-2 for the required fire resistance period.

The system Knauf FPA Acrylic may be used to provide a linear joint or gap seal with specific supporting constructions and substrates (for details see Annex A).

The maximum permitted joint/gap width for system Knauf FPA Acrylic is 100 mm.

3)

- The maximum movement capability of system Knauf FPA Acrylic is $\leq 7.5\%$ 4)
- 5) The provisions made in this European Technical Assessment are based on an assumed working life of the Knauf FPA Acrylic of 30 years, provided that the conditions laid down in sections 4.2/5.1/5.2 for the packaging/transport/ storage/installation/use/repair are met. The indications , low than 85 %. given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected
 - Type Z₂: Intended for uses in internal conditions with humidity lower than 85 % RH excluding

| Product-type: Sealant | Intended use: Linea | Intended use: Linear Joint & Gap Seal | |
|--|--|---------------------------------------|--|
| Assessment method | Essential characteristic | Product Performance | |
| | BWR 2 Safety in case of fire | | |
| EN 13501-1 | Reaction to fire | Class D-s1, d1 | |
| EN 13501-2 | Resistance to fire | Annex A | |
| | BWR 3 Hygiene, health and environment | | |
| Declaration of manufacturer & EN 16516 | Content, emission and/or release of dangerous substances | Declaration of manufacturer | |
| EN 1026:2000 | Air permeability (material property) | No performance determined | |
| EAD 350141-00-1106, Annex C & EN 12390-8 | Water permeability (material property) | No performance determined | |
| | BWR 4 Safety in use | | |
| EOTA TR 001:2003 | Mechanical resistance and stability | No performance determined | |
| EOTA TR 001:2003 | Resistance to impact/movement | No performance determined | |
| EOTA TR 001:2003 | | | |
| ISO 11600 & EAD 350141- 00-1106, Clause 2.2.13 | Adhesion | No performance determined | |
| EAD 350141-00-1106, Clause 2.2.12 | Durability | Z2 | |
| EAD 350141-00-1106, Clause 2.2.13 | Movement capacity | No performance determined | |
| EAD 350141-00-1106, Clause 2.2.14 | Cycling of perimeter seals for curtain walls | No performance determined | |
| EAD 350141-00-1106, Clause 2.2.15 | Compression set | No performance determined | |
| EAD 350141-00-1106, Clause 2.2.16 | Linear expansion on setting | No performance determined | |
| 6 14 | BWR 5 Protection against noise | | |
| EN 10140-1,2,4,5/ EN ISO 717-1 | Airborne sound insulation | Rw(C;Ctr)= 62 (-1;-5) dB* | |
| | BWR 6 Energy economy and heat retentio | n | |
| EN 12664, EN 12667, EN 12939, EN ISO 8990, EN ISO 6946, EN ISO 10456 | Thermal properties | No performance determined | |
| EN 150 12572, EN 12086, EN ISO 10456 | Water vapour permeability | No performance determined | |

3 Performance of the product and references to the methods used for its assessment

4 ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE

According to the decision 1999/454/EC – Commission Decision of date 22nd June 1999 on the procedure for attesting the conformity of construction products pursuant to Article 20(2) of Council Directive 89/106/EEC as regards fire stopping, fire sealing and fire protective products, published in the Official Journal of the European Union (OJEU) L178/52 of 14/07/1999, see http://eur-lex.europa.eu/JOIndex.do) of the European Commission¹, as amended, the system(s) of assessment and verification of constancy of performance (see Annex V to Regulation (EU) No 305/2011) given in the following table(s) applies (apply).

| Product(s) | Intended use(s) | Level(s) or class(es) | System(s) |
|--|---|-----------------------|-----------|
| Fire stopping and Fire Sealing Products | For fire compartmentation and/or fire protection or fire performance | Any | |

5 <u>Technical details necessary for the implementation of the AVCP system, as provided for in the applicable</u> <u>EAD</u>

Tasks of the manufacturer:


Factory production control

The manufacturer shall exercise permanent internal control of production. All the elements, requirements and provisions adopted by the manufacturer shall be documented in a systematic manner in the form of written policies and procedures, including records of results performed. This production control system shall ensure that the product is in conformity with this European technical Assessment.

The manufacturer may only use initial / raw / constituent materials stated in the technical documentation of this European Technical Assessment.

The factory production control shall be in accordance with the Control Plan of 8th April 2013 relating to the European technical assessment ETA 18/0933 issued on 12/12/2018 which is part of the technical documentation of this European technical approval. The "Control Plan" is laid down in the context of the factory production control system operated by the manufacturer and deposited at UL International (UK) Ltd.

The results of factory production control shall be recorded and evaluated in accordance with the provisions of the Control Plan.



Other tasks of the manufacturer

Additional information

The manufacturer shall provide a technical data sheet and an installation instruction with the following minimum information:

- (a) Technical data sheet:
 - Field of application:
 - Building elements for which the linear joint seal or penetration seal is suitable, type and properties of the building elements like minimum thickness, density, and - in case of lightweight constructions – the construction requirements.
 - Limits in size, minimum thickness etc. of the joint or penetration seal
 - Construction of the linear joint seal or penetration seal including the necessary components and additional products (e.g. backfilling material) with clear indication whether they are generic or specific.
 - Services which the penetration seal is suitable, type and properties of the services like material, diameter, thickness etc. in case of pipes including insulation materials; necessary/allowed supports/fixings (e.g. cable trays)
- (b) Installation instruction:
 - Steps to be followed
 - Procedure in case of retrofitting
 - Stipulations on maintenance, repair and replacement
- 6 Issued on:

12th December 2018

Report by:

D. Yates Project Engineer Building and Life Safety Technologies


For and on behalf of UL International (UK) Ltd.

Reviewed by:


C. Johnson Staff Engineer Building and Life Safety Technologies


ANNEX A – Resistance to Fire Classification – Knauf FPA Acrylic

- A.1 Flexible wall constructions according to 2 1) with wall thickness of minimum 75 mm and minimum 1 x layer of 12.5 mm board per side
- A.1.1 Linear joint seals, between head of flexible wall and soffit of concrete floor and vertical end of flexible wall and concrete wall

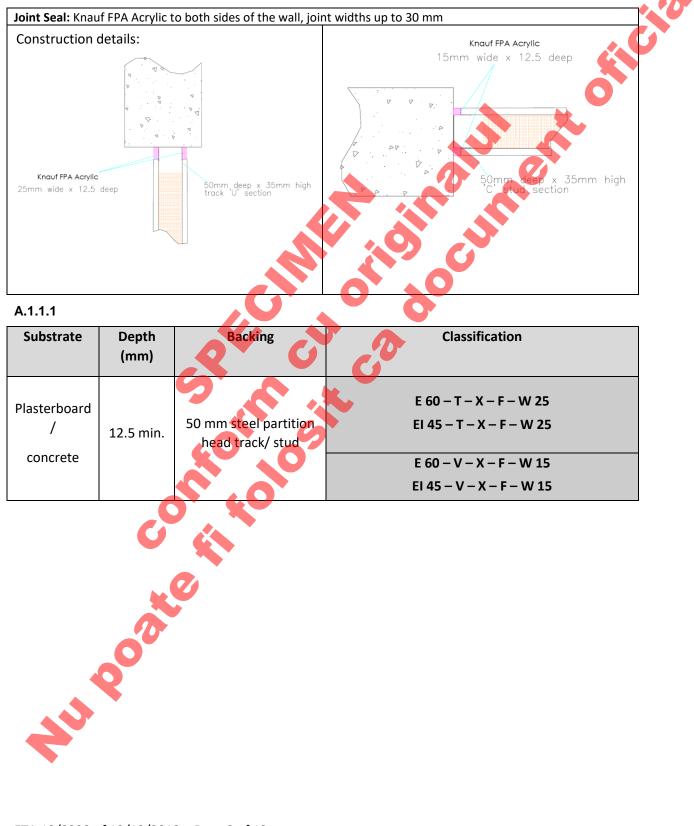

A.2 Flexible wall constructions according to 1.2.1 with wall thickness of minimum 100 mm and minimum 2 x layer of 12.5 mm board per side



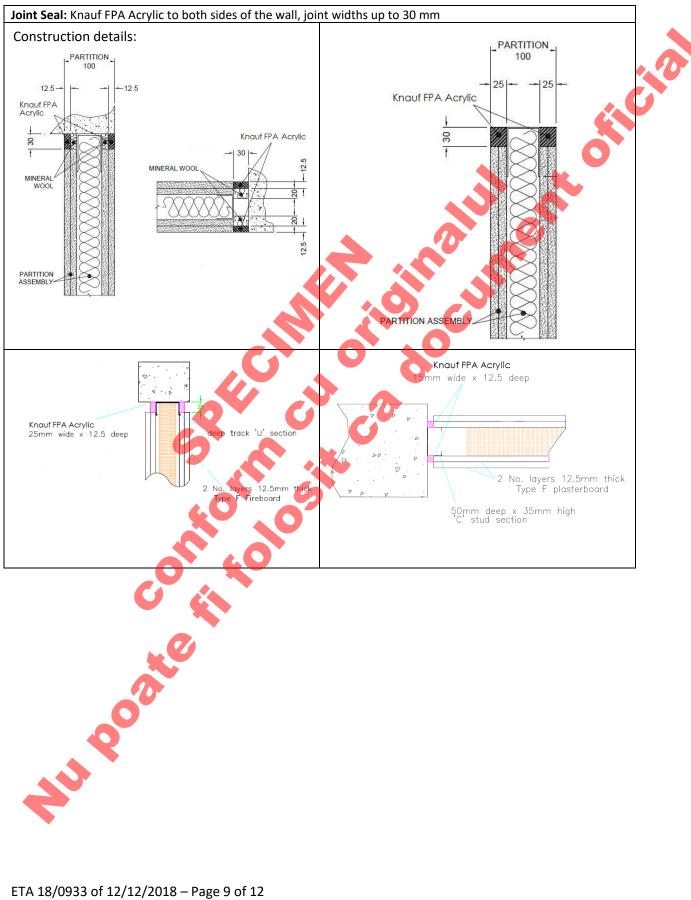


A.2.1.1

| Substrate | Depth (mm) | Backing | Classification |
|-------------------------------|---------------|--|--|
| | 12.5 min. | 12.5 mm Stone wool 35 kg/m ³ plus 50 mm steel partition head track | EI 120 – T – X – F – W 00 to 30 |
| Plasterboard / concrete | | 20 mm Stone wool 35 kg/m ³ * | EI 120 – V – X – F – W 00 to 30 |
| concrete | 25 min. | | EI 120 – T – X – F – W 00 to 30 |
| | 12.5 min. | 50 mm steel partition head track /stud | EI 90 - T - X - F - W 25 EI 90 - V - X - F - W 15 |
| | | | |
| | ç | | |
| | | | |

A.3 Rigid wall constructions according to 1.2.1 with wall thickness of minimum 150 mm

A.3.1 Linear joint or gap seal, between head of rigid wall and soffit of concrete floor / between rigid walls

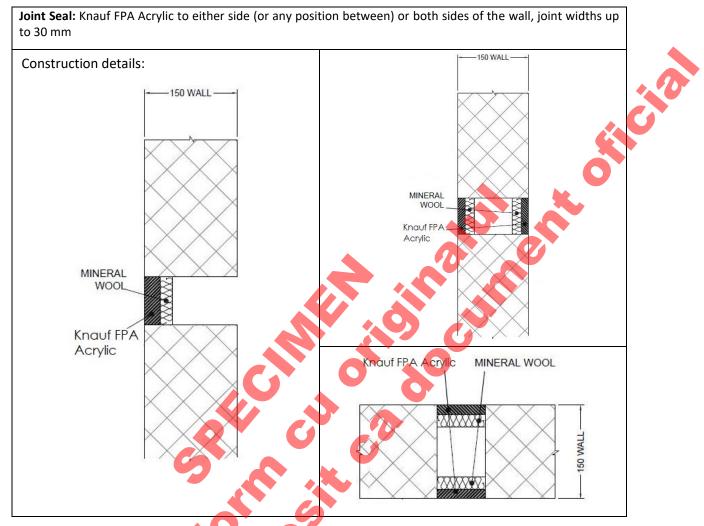


A.3.1.1

| Substrate | Depth 🌈 | Backing | Classification |
|-----------|-----------------------|--|---|
| | (mm) | | |
| | 25 min. | | E 240 – T – X – F – W 00 to 30 |
| | (one side) | 20 mm Stone wool 40 kg/m ³ | EI 60 – T – X – F – W 00 to 30 |
| | 15 min. | | EI 240 – V – X – F – W 00 to 30 |
| masonry/ | (both sides) | | EI 240 – T – X – F – W 00 to 30 |
| indsoni y | 10 min. | | E 240 – T – X – F – W 50 |
| concrete | (one side) | 60 mm Stone wool 33 kg/m ³ | EI 60 – T – X – F – W 50 |
| | | | EI 120 – V – X – F – W 50 |
| 40 | 25 min. (one side) | 48 mm AES Fibre ≥ 128kg/m ³ | E 240 – T – X – F – W 00 to 30 El 120 – T – X – F – W 00 to 30 |

A.4 Rigid floor constructions according to 1.2.1 with floor thickness of minimum 150 mm

A.4.1 Linear joint or gap seal, between floor slabs or between floor slab and wall with sealant to the top face of the floor only

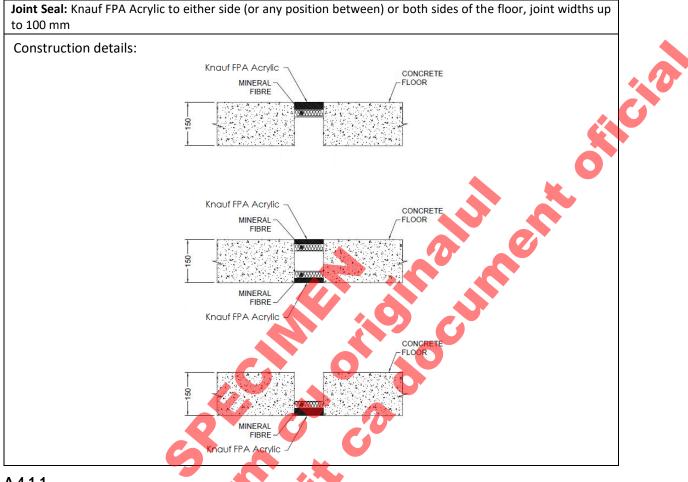

A.4.1.1

| Substrate | Depth (mm) | Backing | Classification |
|---|------------------------------|---|--|
| | 25 min. (any position) | 25 mm AES Fibre ≥ 128kg/m³ | E 120 – H – X – F – W 00 to 100 El 60 – H – X – F – W 00 to 100 |
| masonry/ | 25 min (top face) | | El 180 – H – X – F – W 00 to 100 |
| | 15 min. | 25 mm Stone wool 40 kg/m ³ | EI 120 – H – X – F – W 00 to 100 |
| concrete | (both sides) | 25 mm Stone wool 140 kg/m ³ | EI 180 – H – X – F – W 00 to 100 |
| | 15 min. (both sides) | 25 mm stone wool 35 kg/m ³ insulation | EI 240 – H – X – F – W 00 to 30 |
| ~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~ | 10 min. (top face) | 90 mm Stone wool 33 kg/m ³ | EI 240 – H – X – F – W 100 |